


Venting Termination Clearances

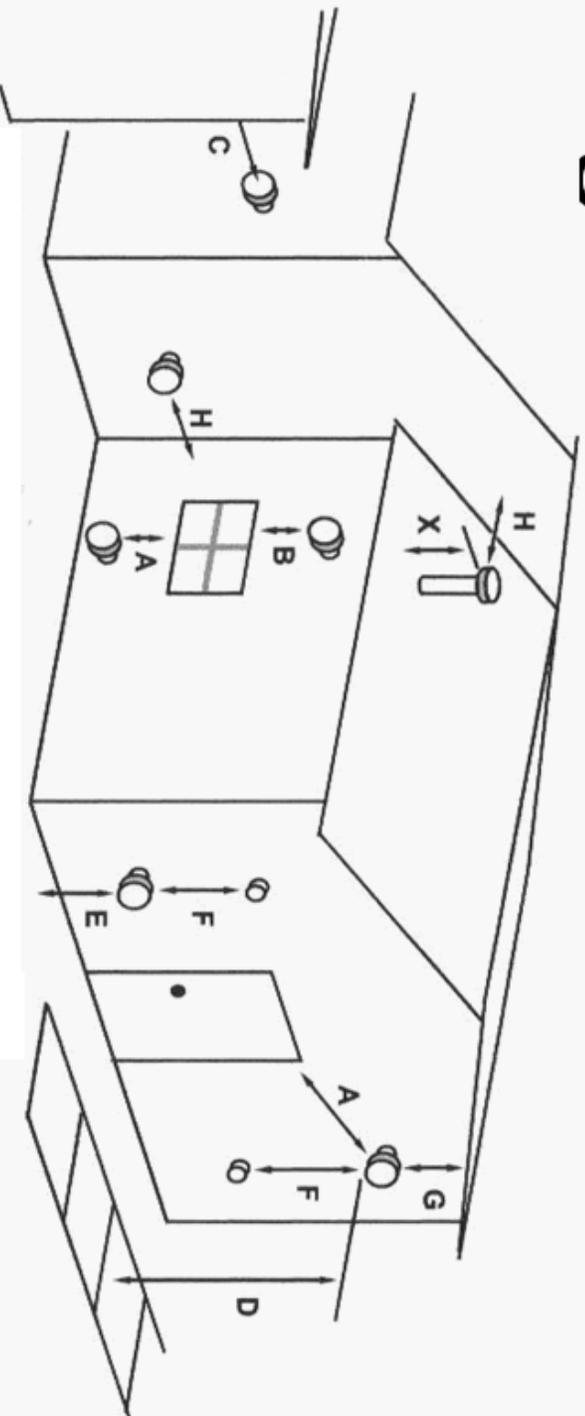

NOTE: Measure clearances to the nearest edge of the exhaust

- A Minimum 4' clearance below or beside any door or window that opens
- Minimum 1' clearance below or beside any window that does not open.
- B Minimum 1' clearance above any door or window that opens
- C Minimum 2' clearance from any adjacent building
- D Minimum 7' clearance above any grade when adjacent to public walkways
- NOTE:** Vent may not terminate in covered walkway or breezeway.
- E Minimum 2' clearance above any grass, plants, or other combustible materials
- F Minimum 3' clearance from any forced air intake of any other appliance
- G Minimum 2' clearance below eaves or overhangs
- H Minimum 1' clearance horizontally from combustible wall
- X Must be a minimum of 2' above the roof

Not less than 4 feet below, 4 feet horizontally from, or 1 foot above any door, window, or gravity air inlet